

**FINAL
ENVIRONMENTAL IMPACT STATEMENT**

for the


TRI-LAKES RELIABILITY PROJECT



February 17, 2006

ATTACHMENTS FOR RESPONSE 13

Revised substation landscaping plans

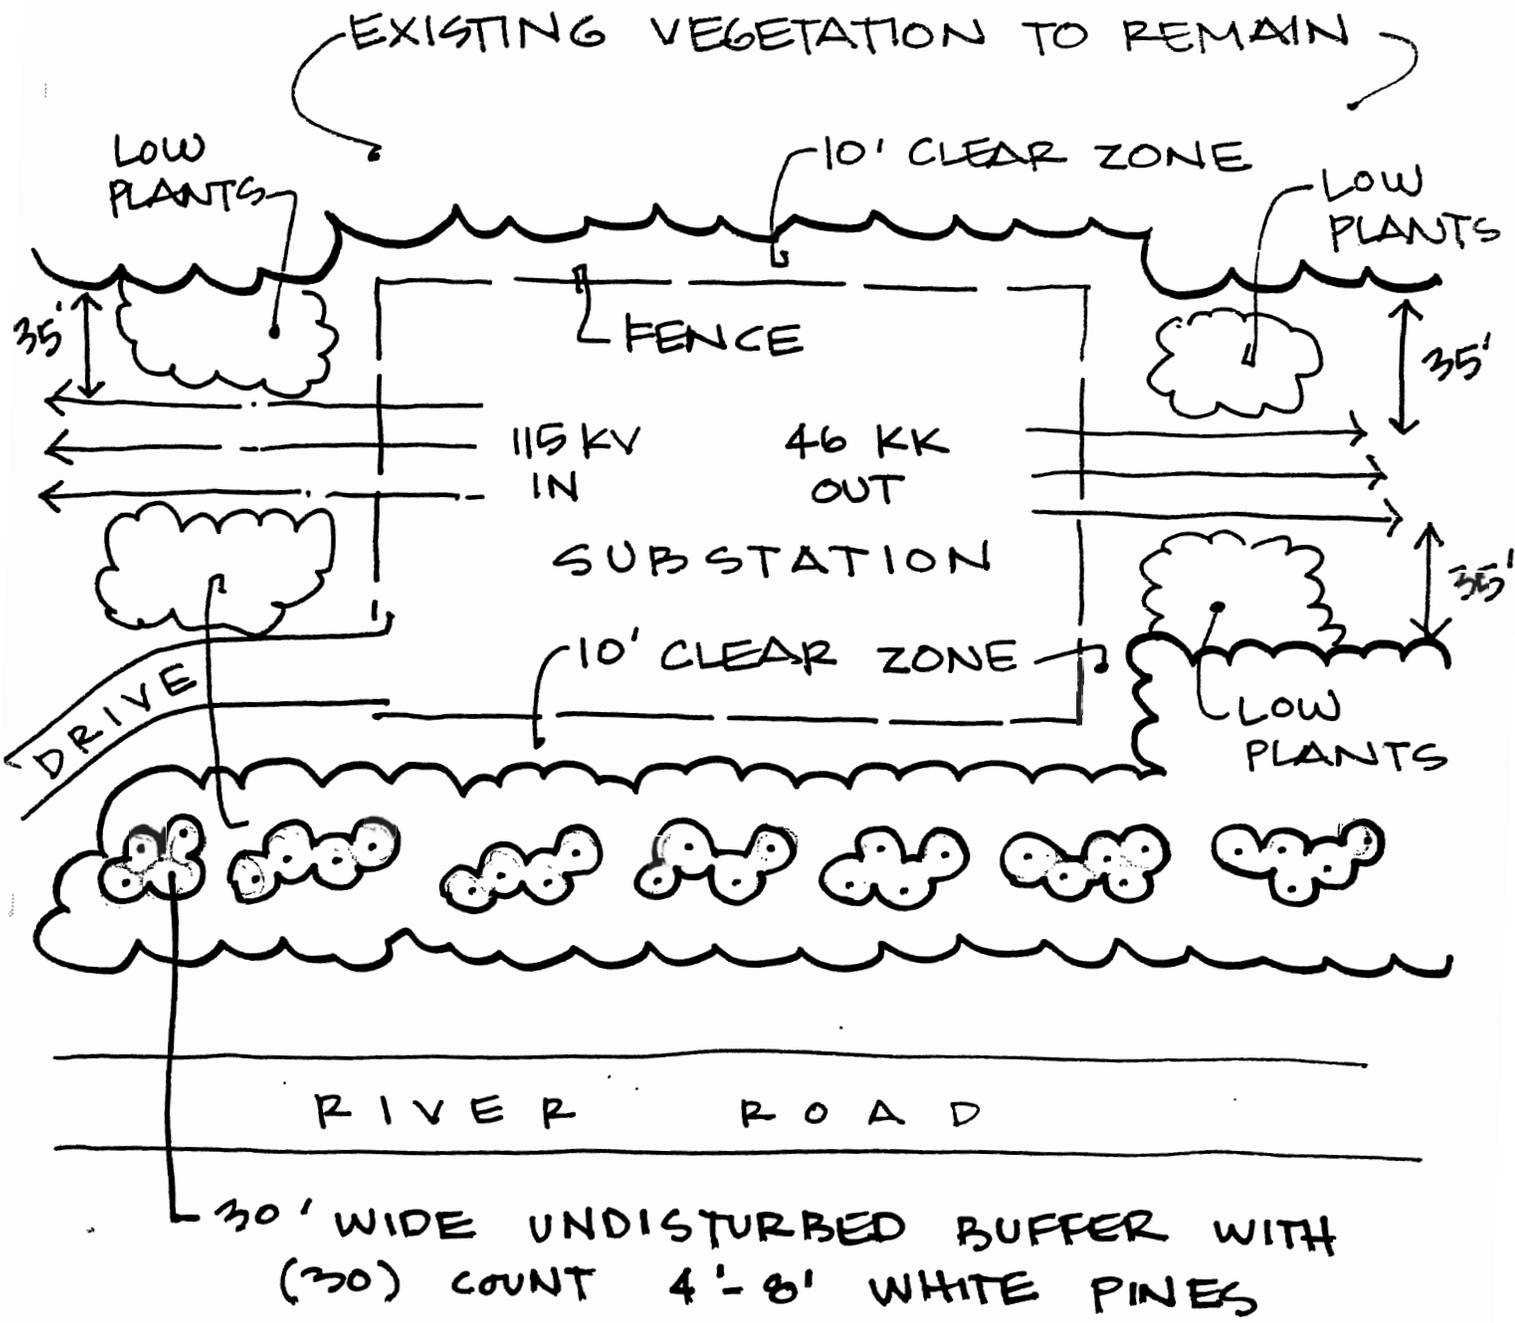

STARK FALLS
SUBSTATION
SITE PLAN

1"=50'

RAQUETTE

RIVER

PROVIDE 35 4-8' WHITE PINE INFILL
PLANTINGS
200 FT UNDISTURBED
VEGETATED BUFFER



75'
TYP
ROW

46 KV

46 KV

REGULATOR
STATION

DRIVE


FENCE



100 FT UNDISTURBED
VEGETATED BUFFER



PIERCEFIELD STATION
LANDSCAPE PLAN NTS

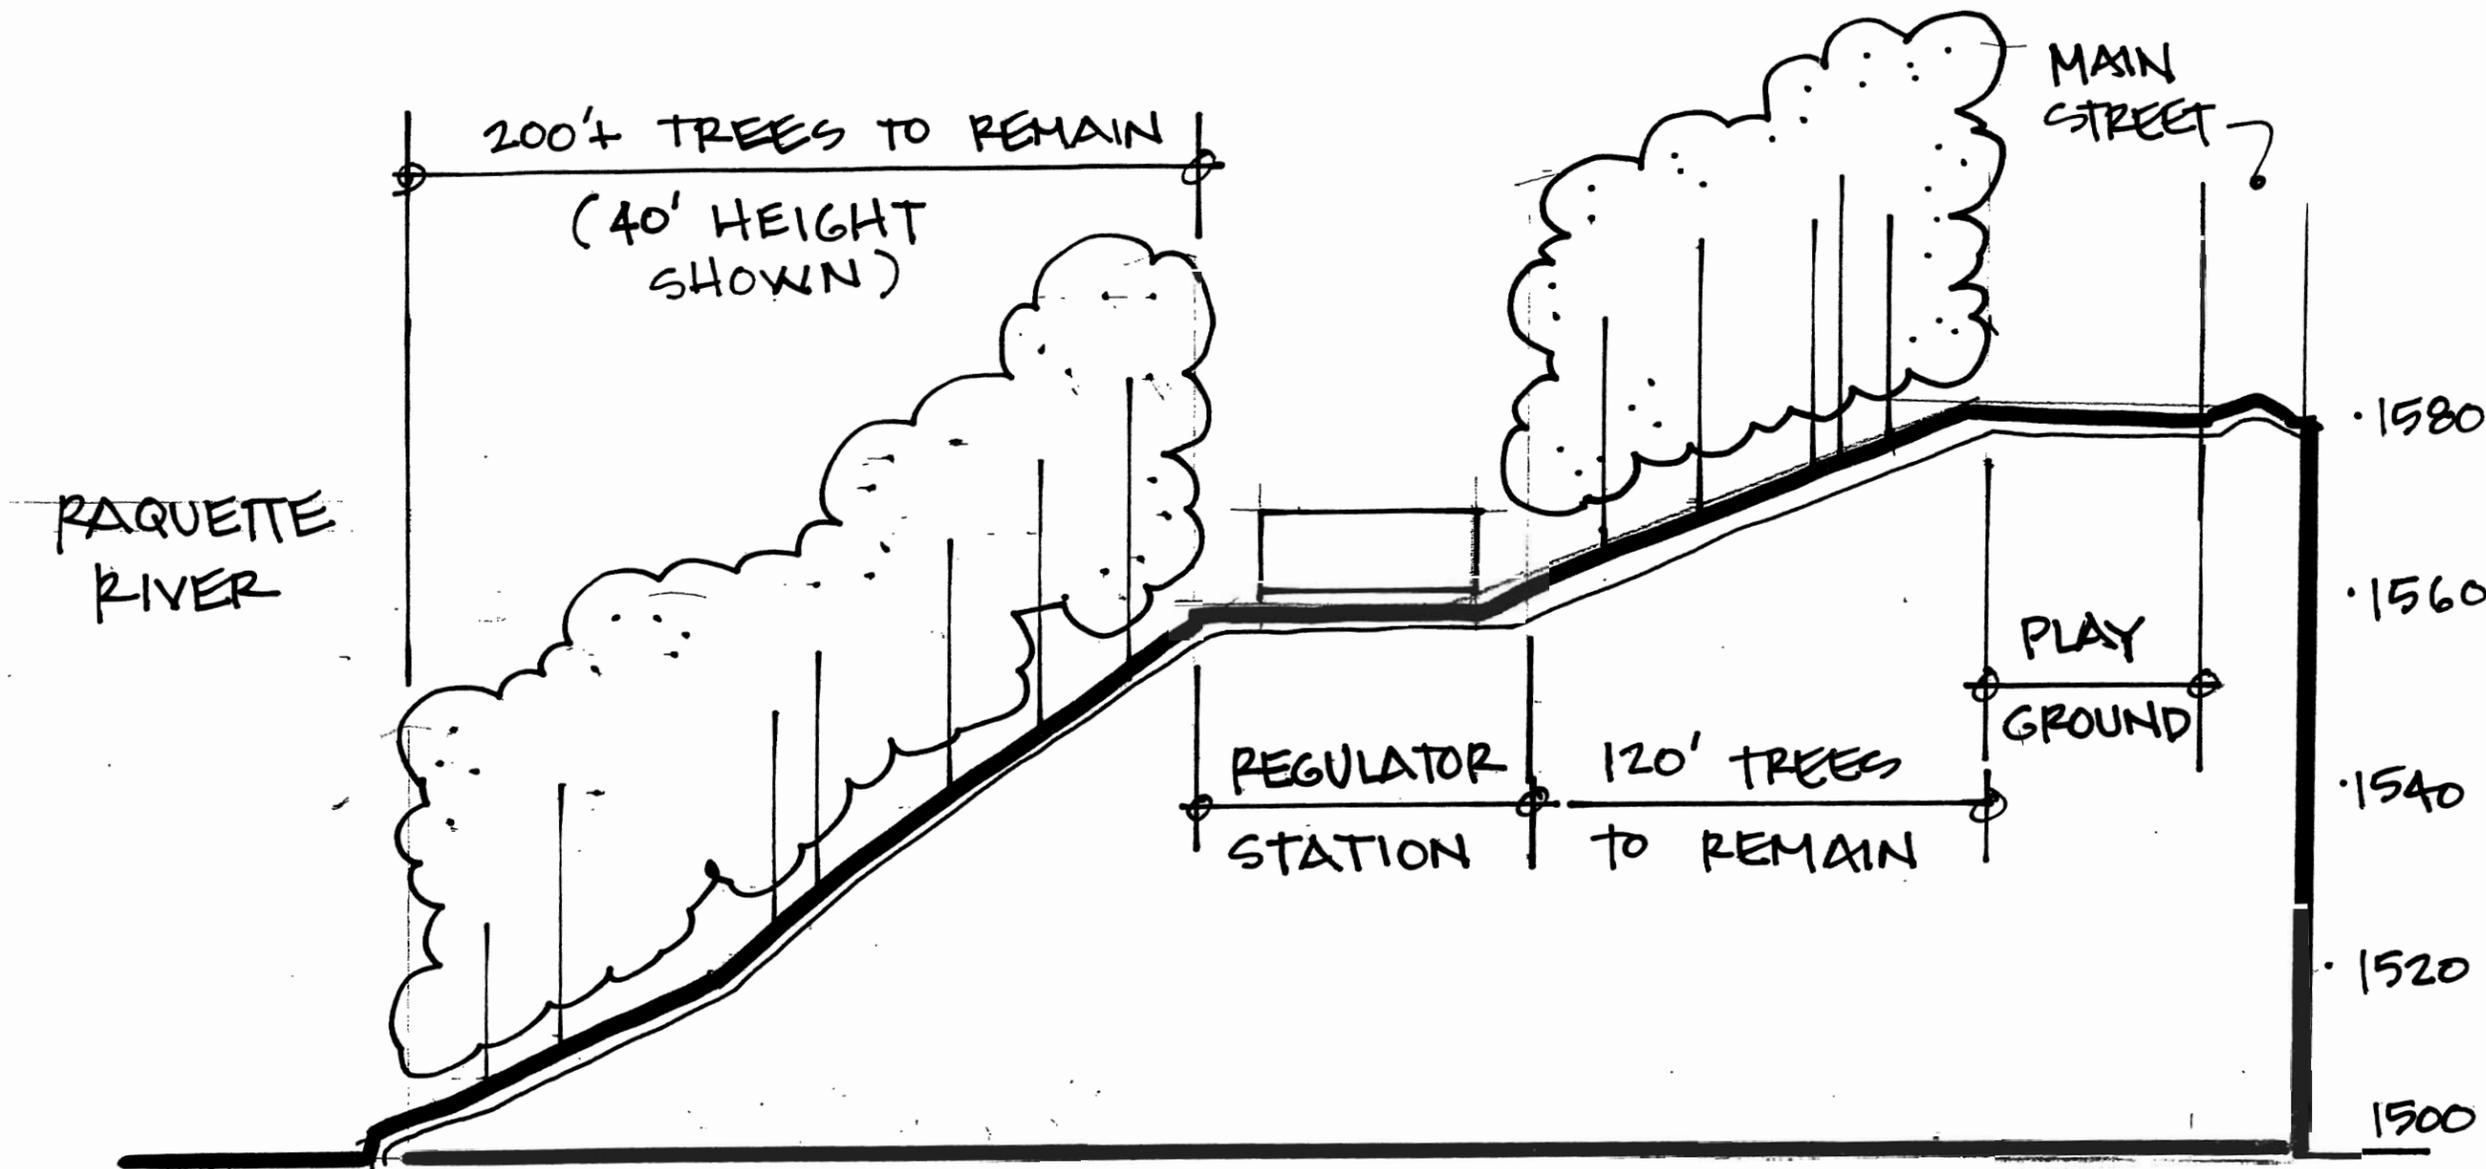

SECTION THRU PIERCEFIELD STATION
 H 1" = 50 V 1" = 20

VISUAL SECTION	
 New York Power Authority	Figure #